

Figure 1:

SDS-PAGE of nPhl p 1, rPhl p 1-LM and rPhl p 1-HM

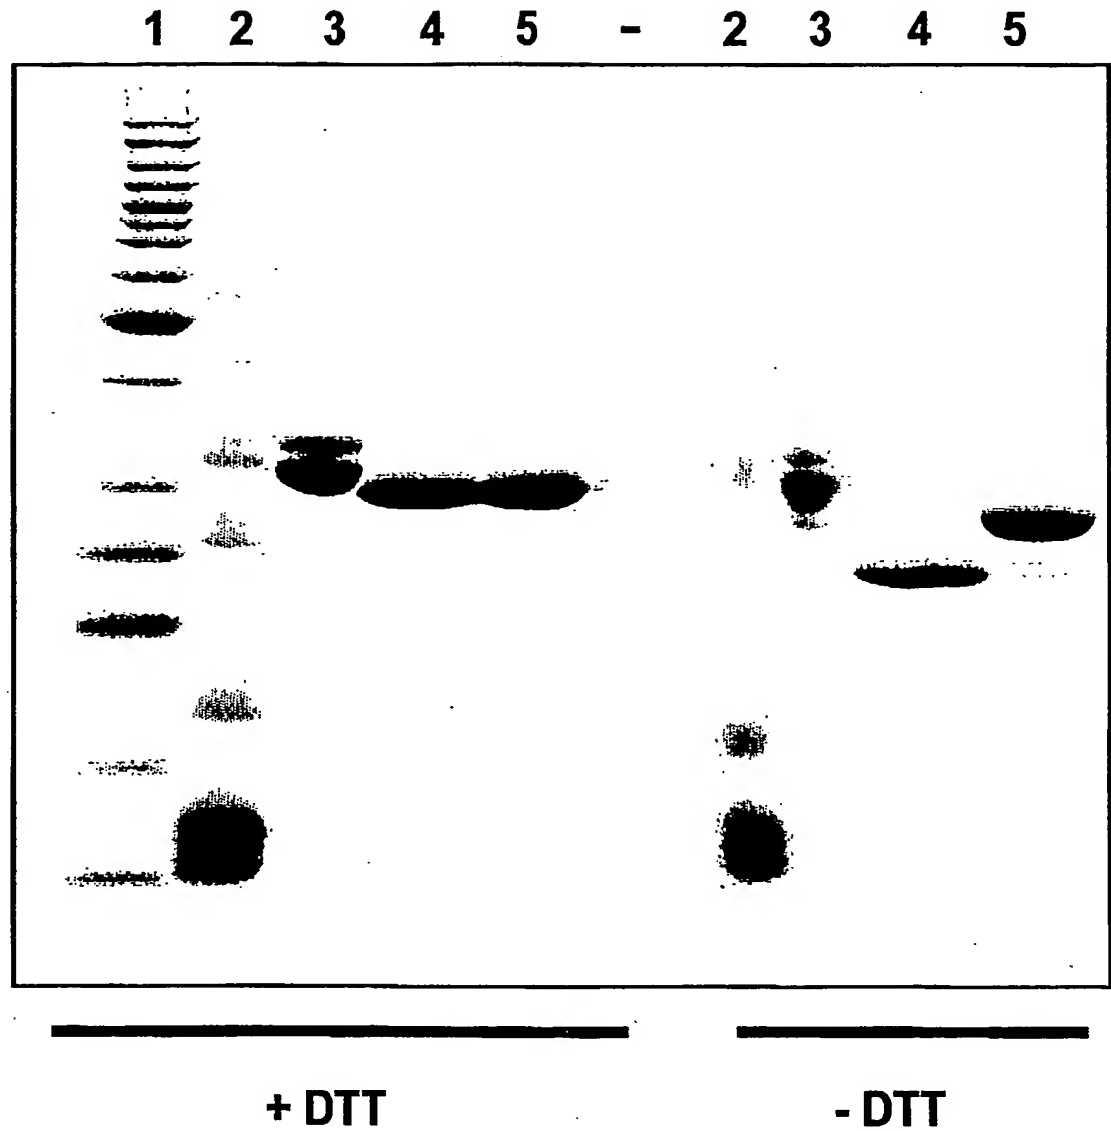
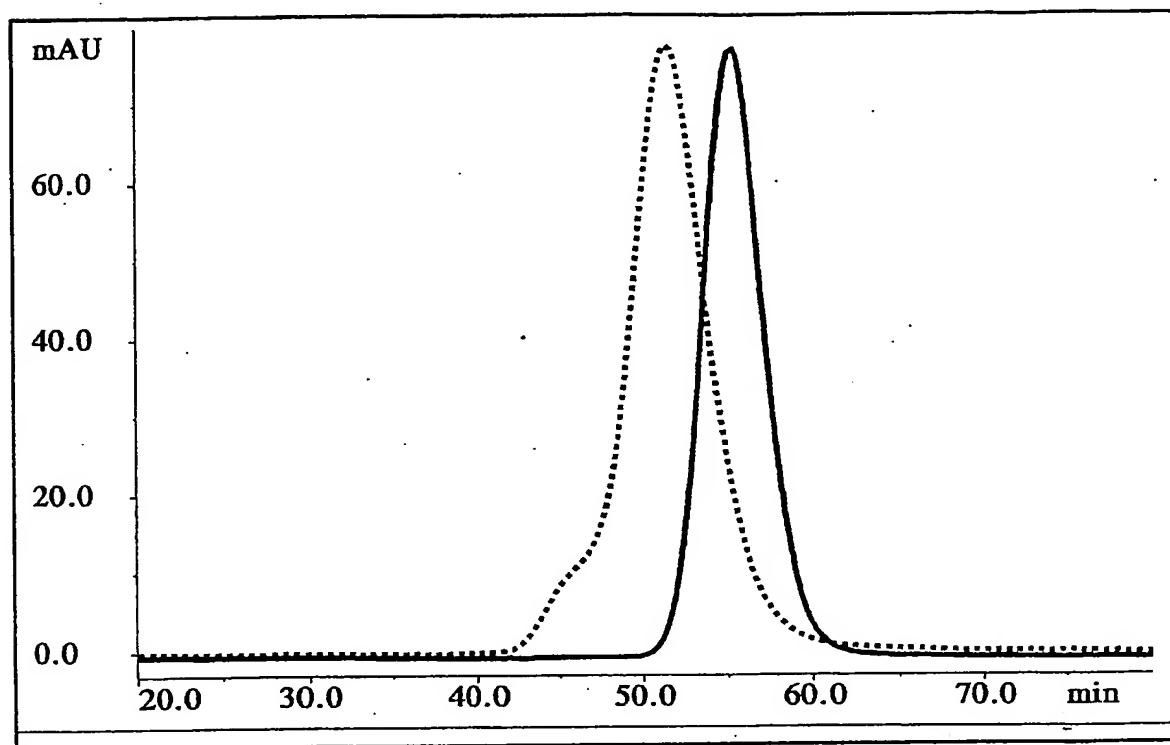


Figure 2: Gel filtration with rPhl p 1-HM and rPhl p 1-LM

.....rPhl p 1-HM

_____rPhl p 1-LM

Elution at: 51.41 min

55.22 min

Figure 3:

EAST inhibition test with fold variants rPhl p 1-T236C-LM and -HM

